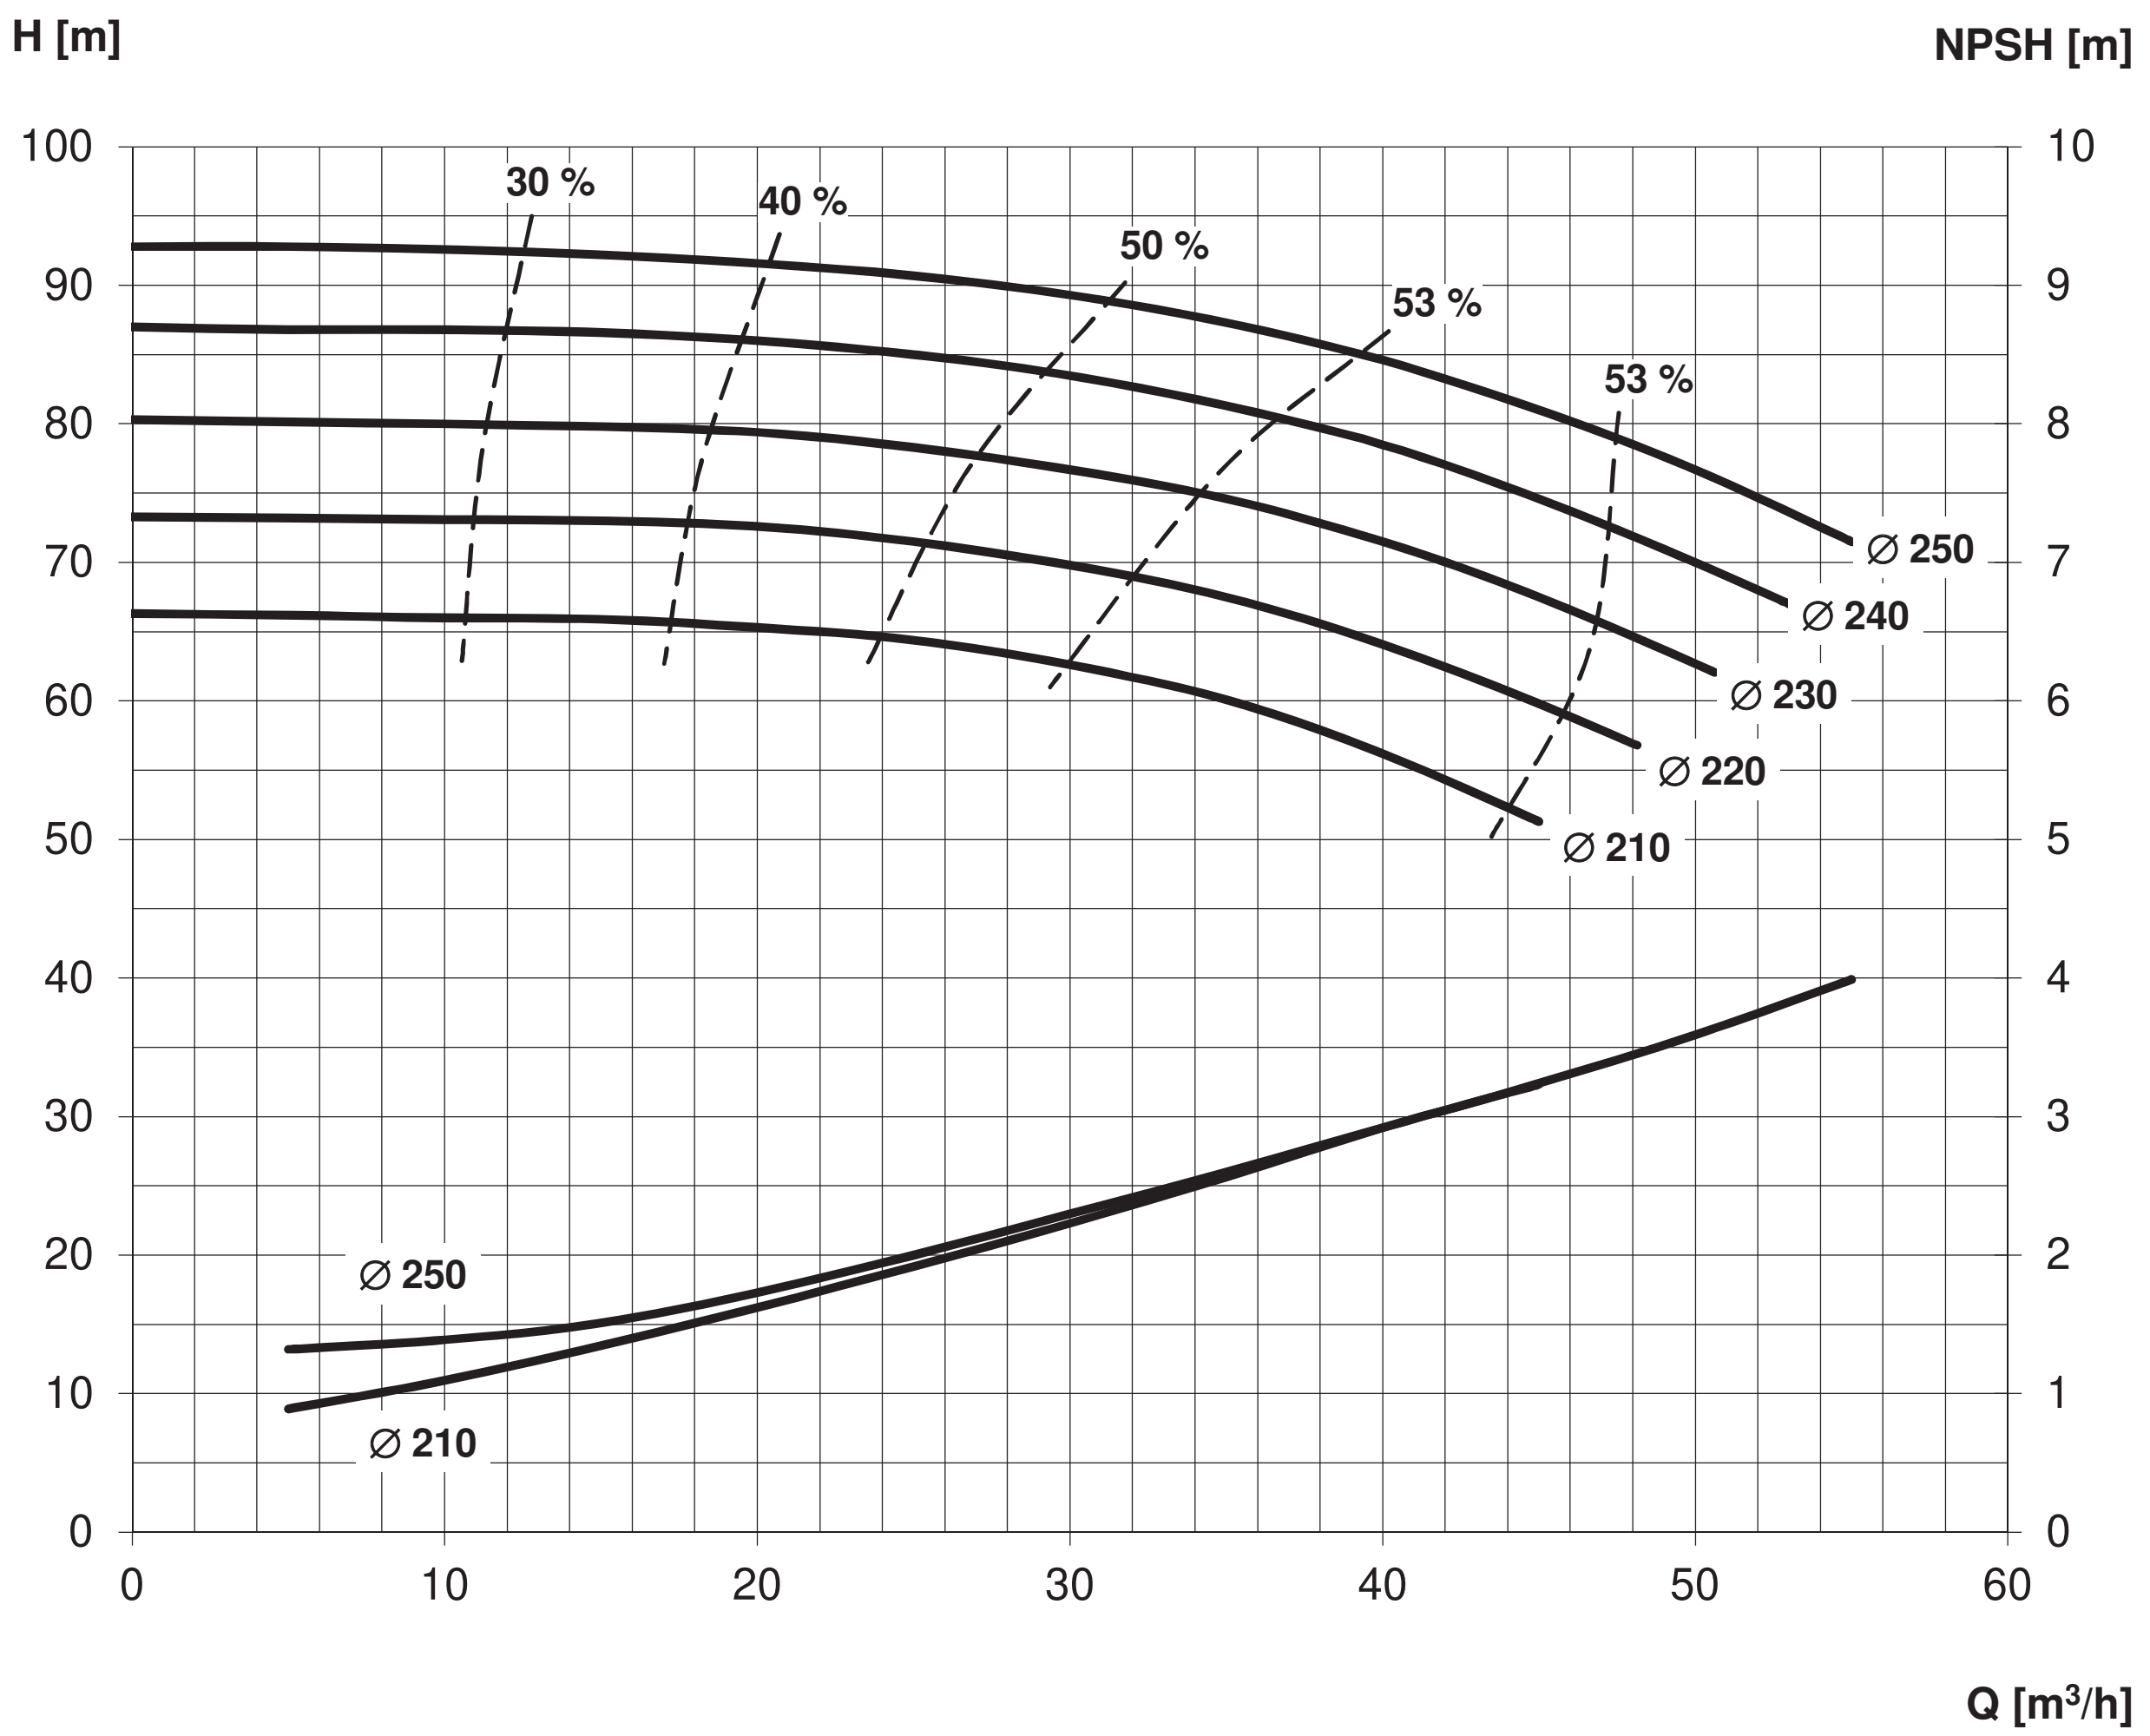

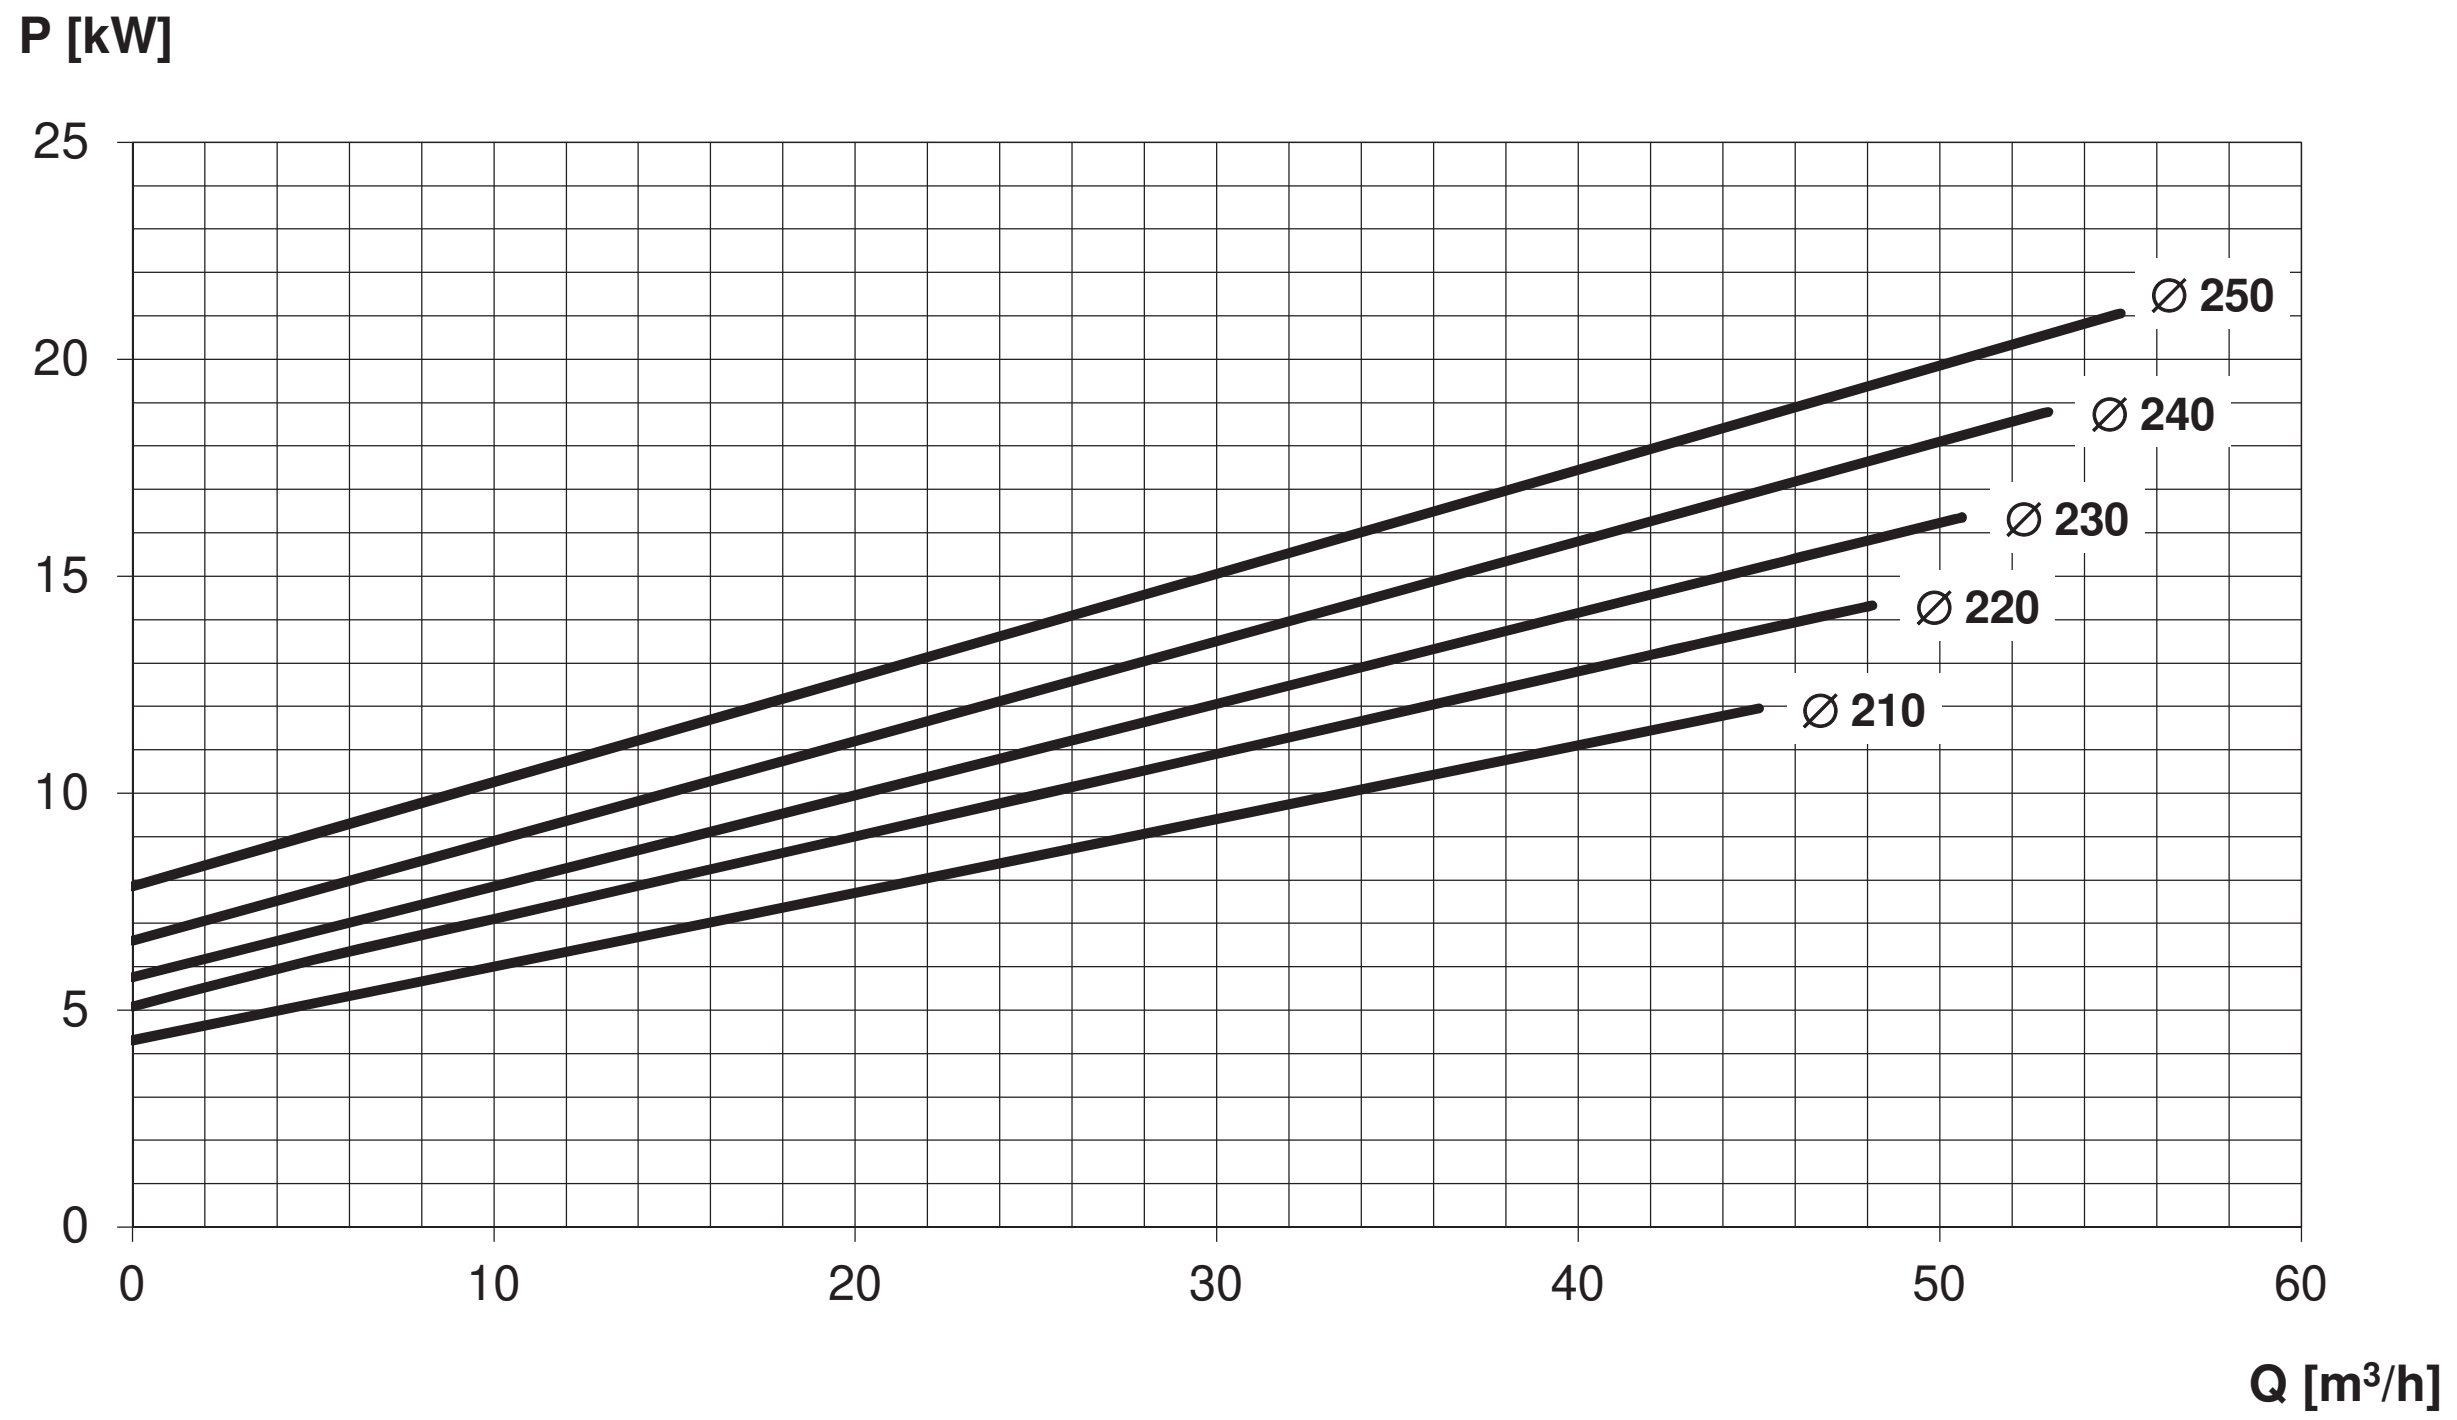

A tolerance of ± 5% applies to all figures Based on tests using 20°C water	name : Tho date : 20.08.09	**FP 752**
Inlet: DN 80 **Outlet: DN 50**	**n = 2900 min^{-1}**	

Aug-09

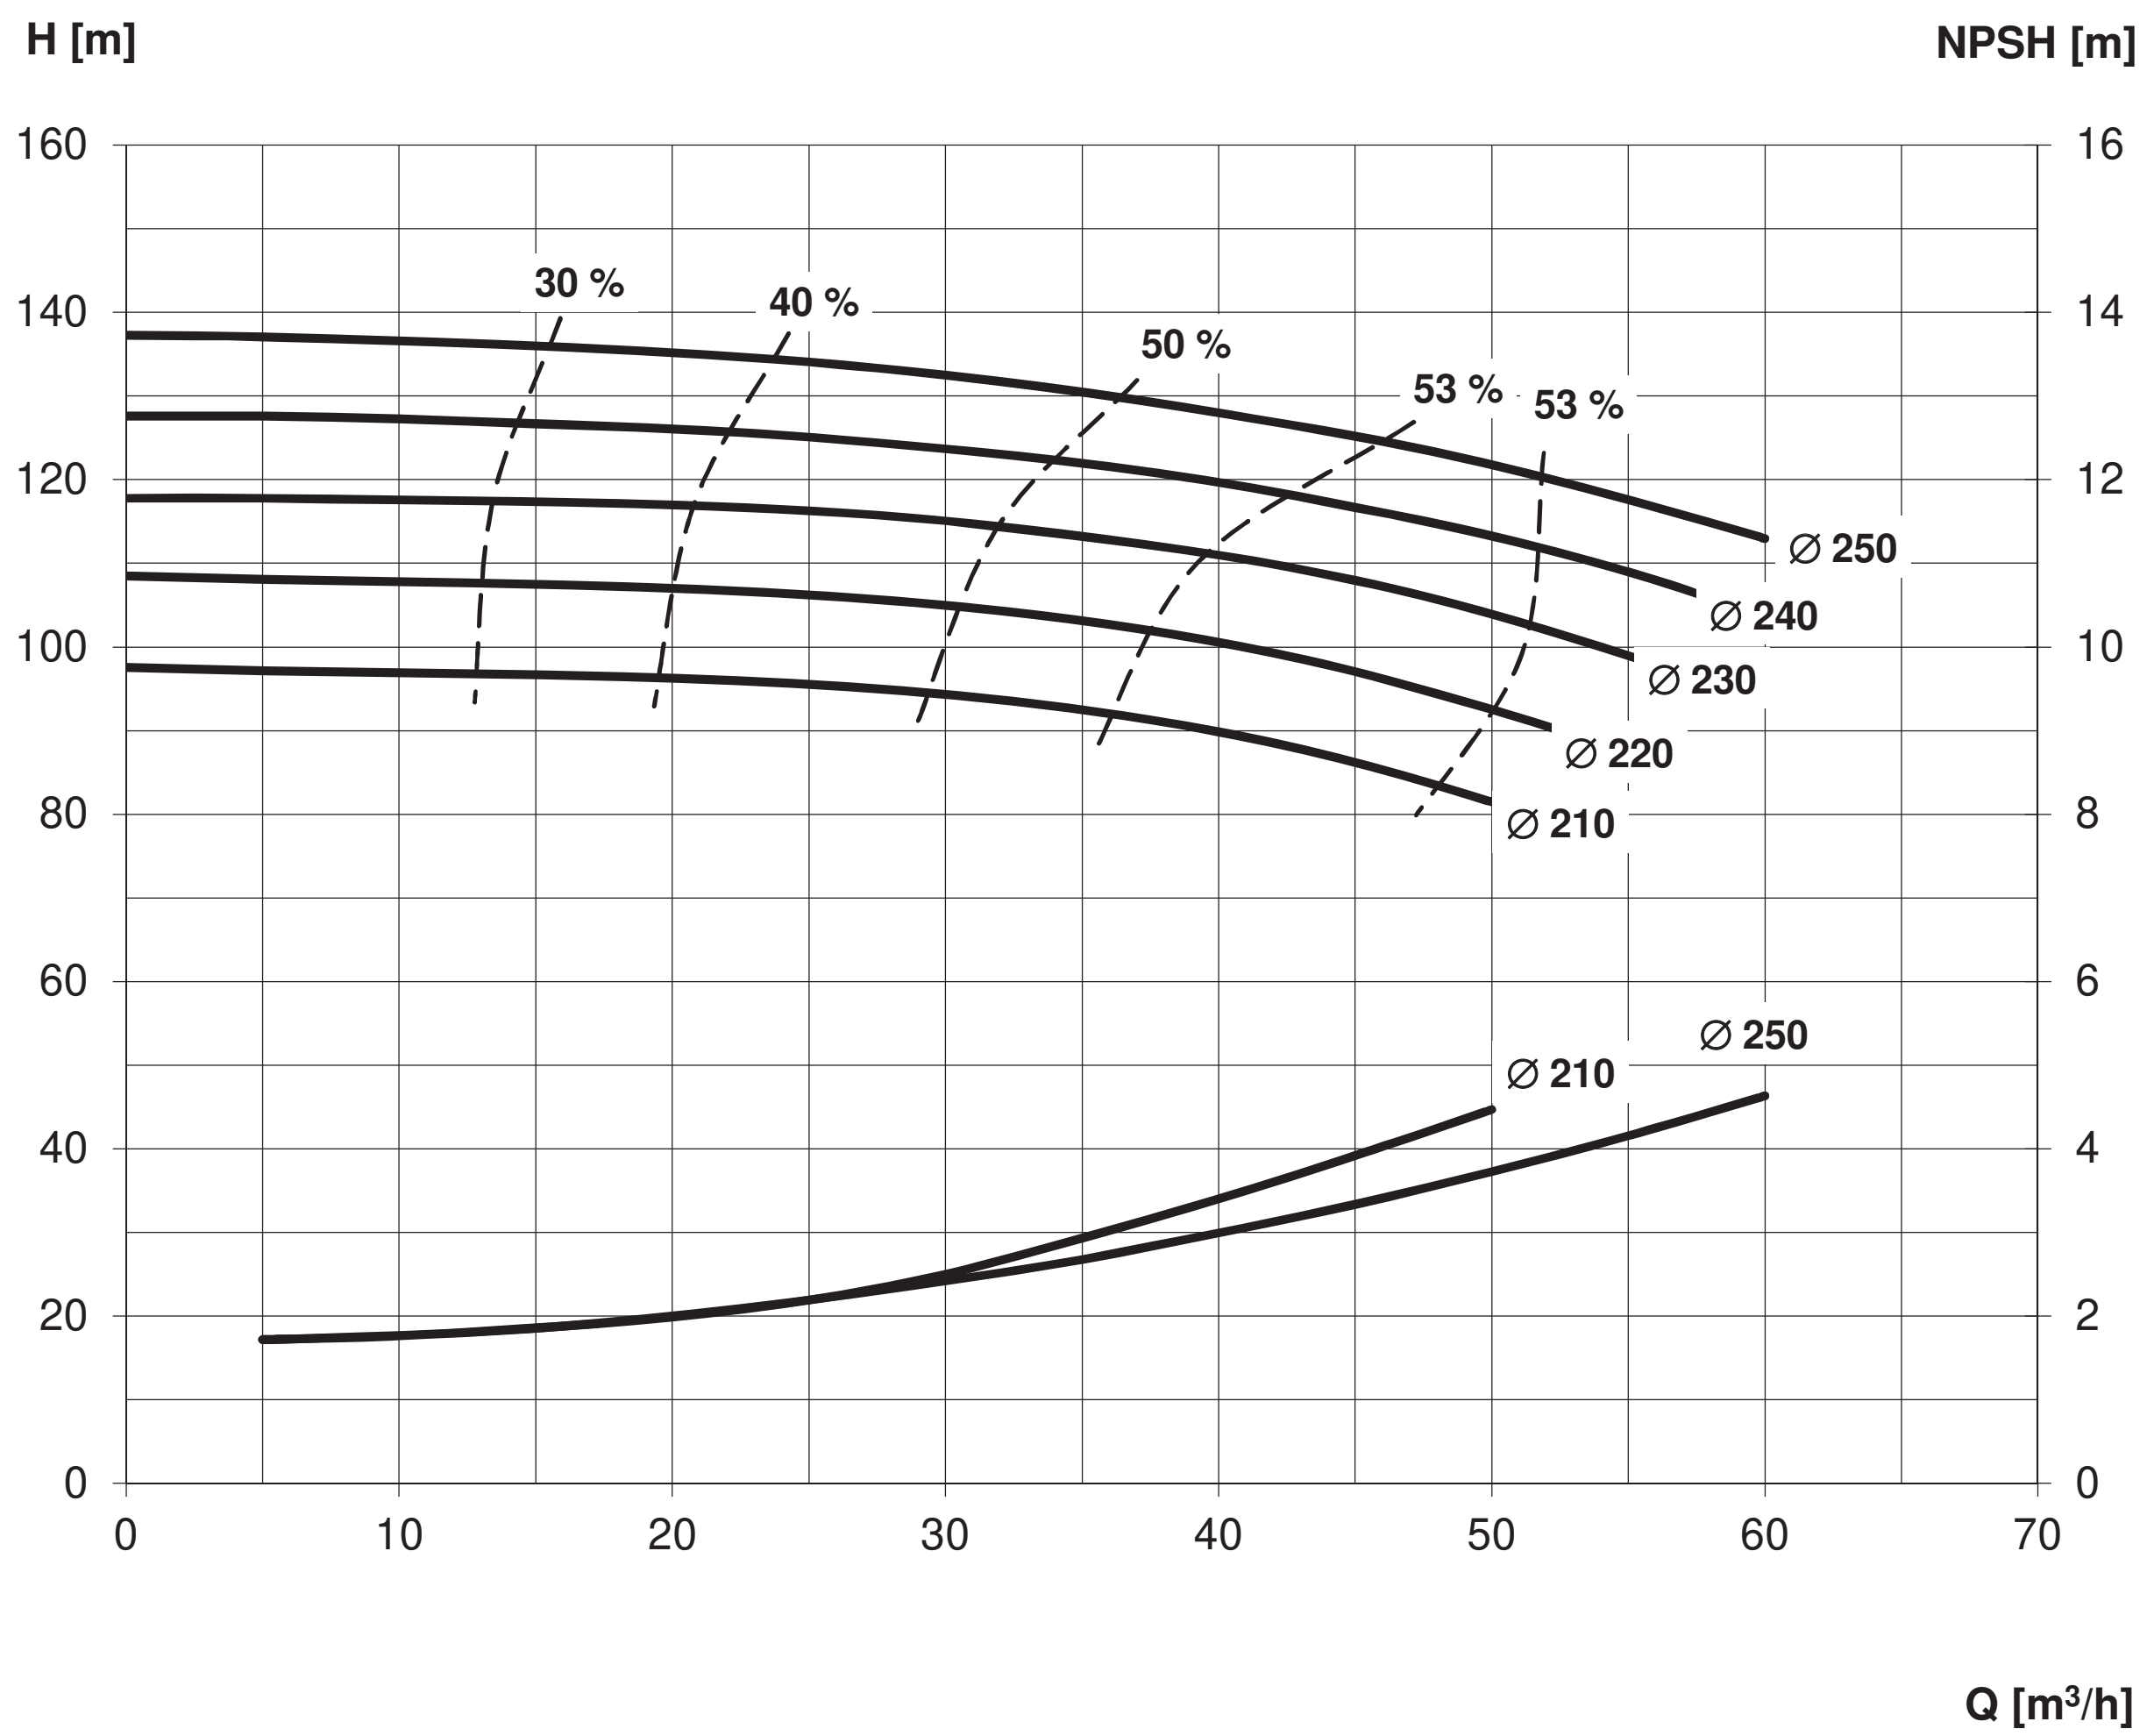

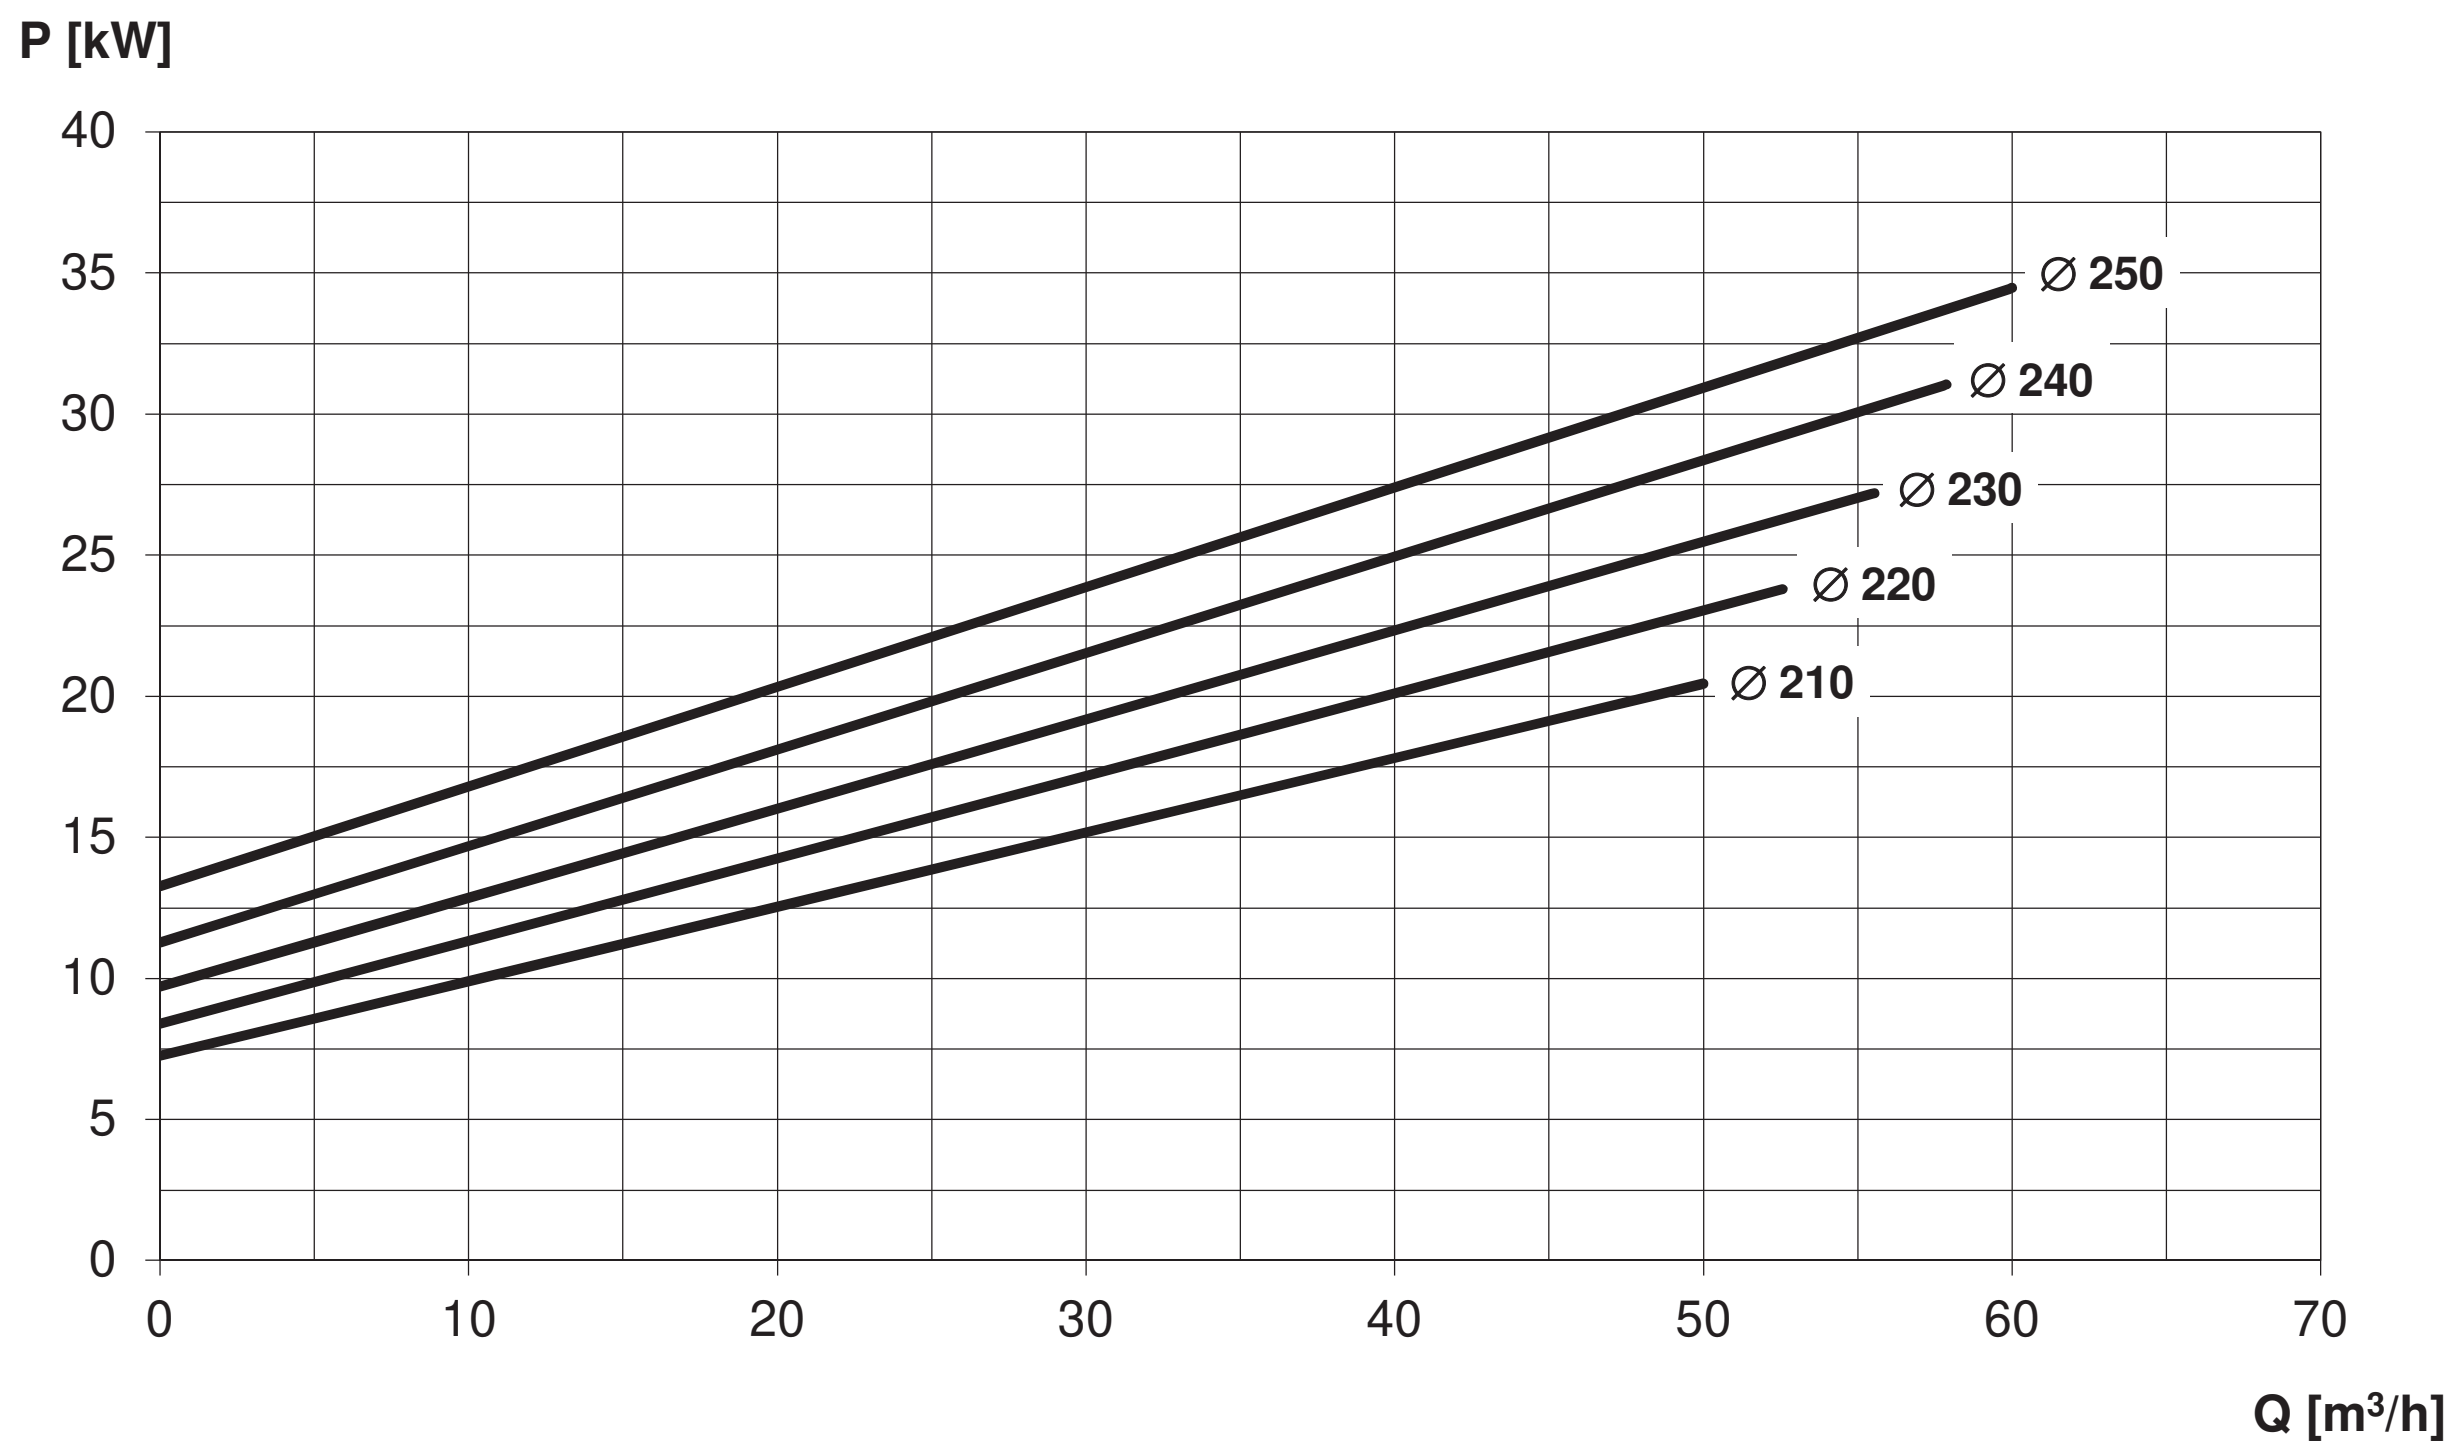

A tolerance of ± 5% applies to all figures Based on tests using 20°C water	name : Tho date : 20.08.09	**FP 752**
Inlet: DN 80 **Outlet: DN 50**	**n = 3500 min^{-1}**	

Aug-09